


DATE	REVISION
A 13.4.11	PLAN UPDATED FOLLOWING COMPLETION OF MAJOR REFURBISHMENT & EXTENSION WORKS
B 16.9.11	PLAN UPDATED FOLLOWING WORKS TO INCREASE CAPACITY OF KG02 MARCONI LT
C 15.3.12	PREMISES INFORMATION BOX ADDED
D 30.9.14	MAX. OCCUPANCY FOR KGS1 ADDED TO FSD SPEC.
E 4.2.15	'CL.STORE' ADDED. KG01b CHANGED TO 'STORE'
F 23.9.16	EXTINGUISHERS ADDED
G 9.6.17	ELECTRICAL SHUT-OFF POINT ADDED

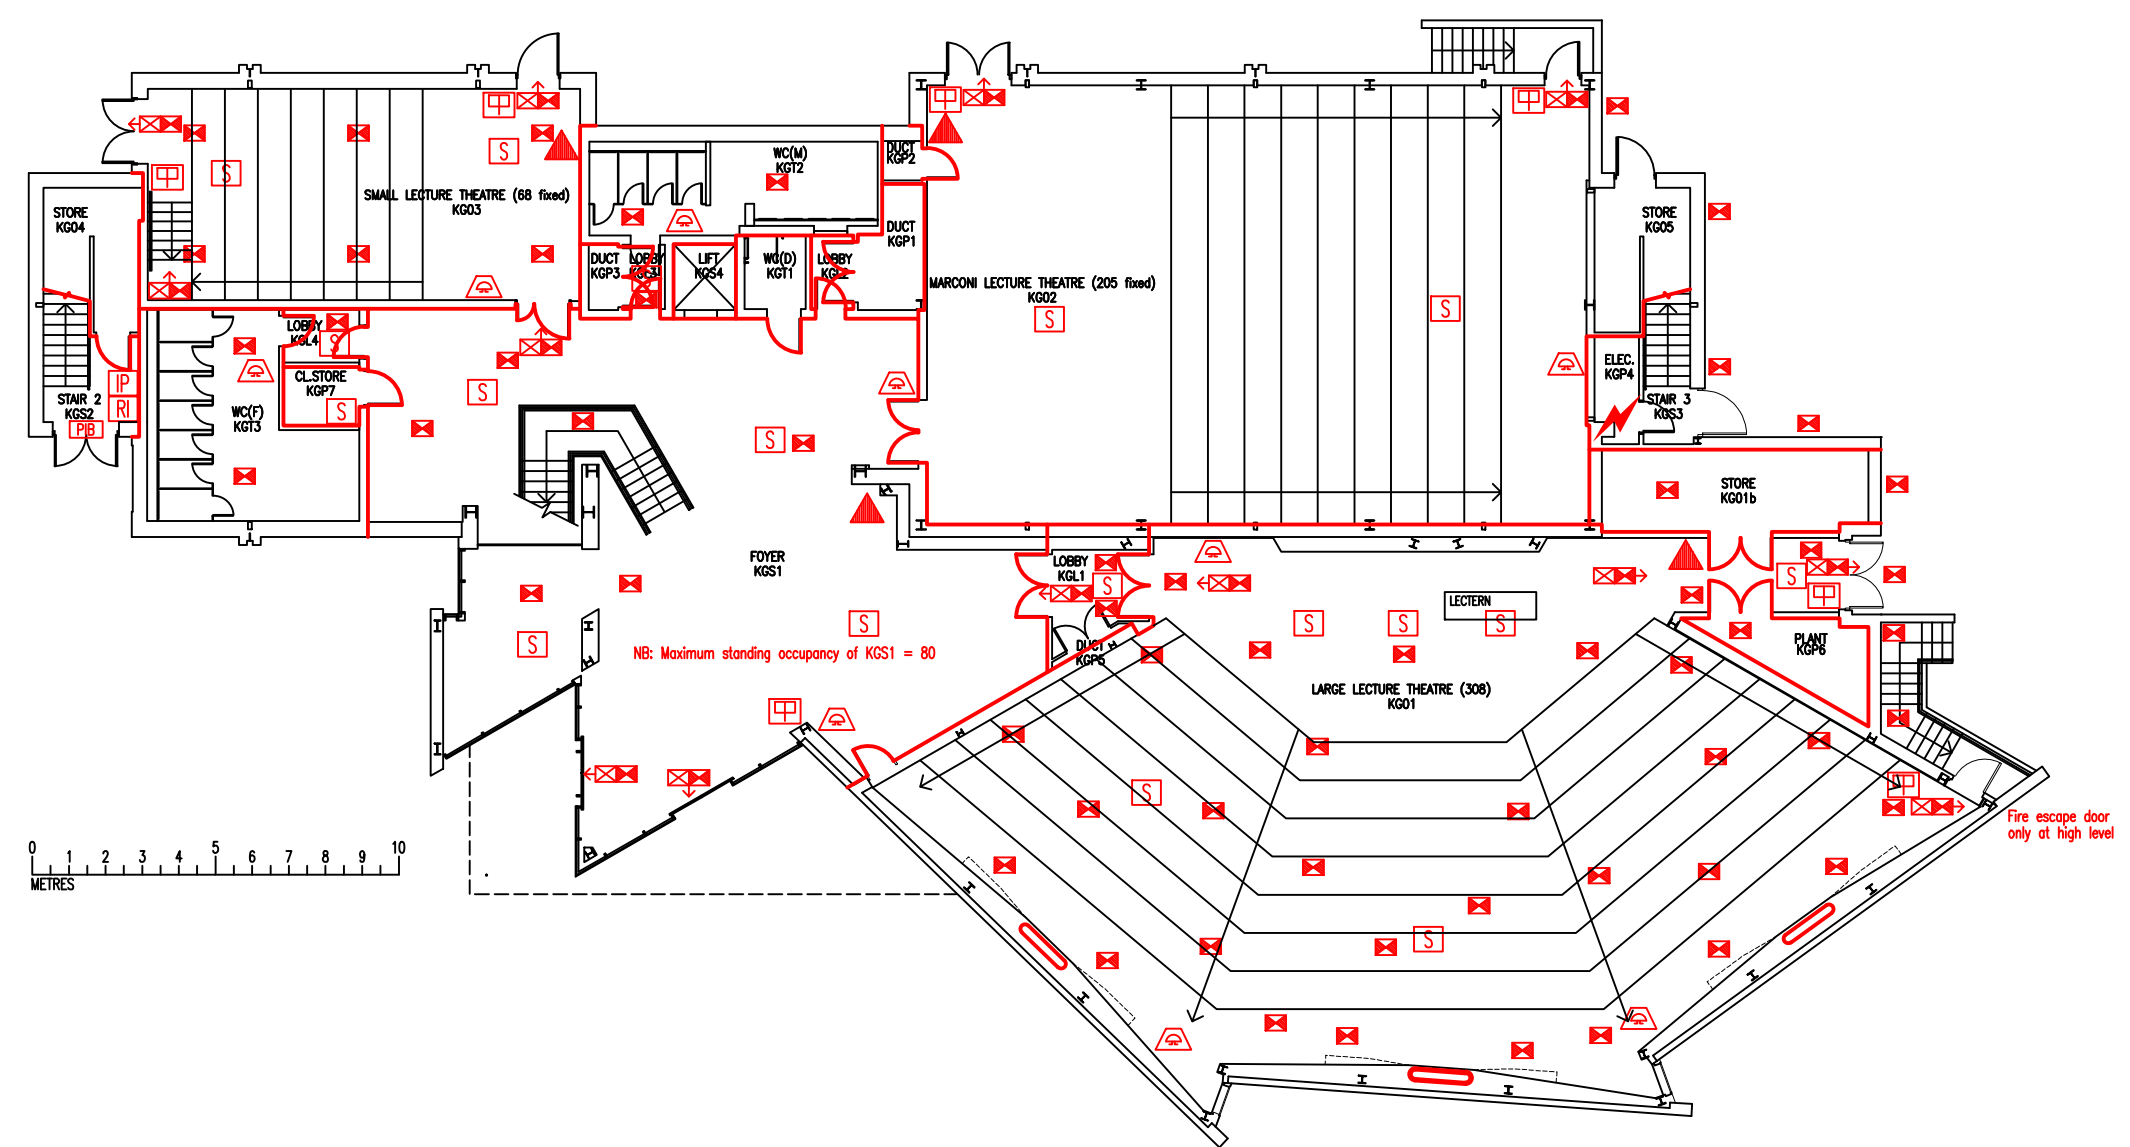

0 1 2 3 4 5 6 7 8 9 10  
METRES

NB: Maximum standing occupancy of KGS1 = 80

Fire escape door only at high level

- Key to Fire Symbols
- Existing fire alarm control panel
  - Existing refuge indicator panel
  - Existing fire resisting construction 30 min.
  - Existing premises information board
  - Existing 6 litre P50 foam fire extinguisher
  - Existing call point - manual
  - Existing exit sign - internally illuminated
  - Existing emergency lighting luminaire
  - Existing audible warning device
  - Existing smoke detector
  - Existing fire action sign - general
  - Denotes directional arrow on existing fire exit sign
  - Electrical shut-off point for building

GROUND FLOOR  
FIRE PLAN

KIMMERIDGE  
HOUSE

KH/FP/1G

SCALE 1:150 at A3  
DECEMBER 2006

