


DATE	REVISION
A 18.5.10	PLAN UPDATED FOLLOWING FSO SURVEY
B 23.9.16	EXTINGUISHER POSITIONS & TYPES UPDATED
C 27.9.17	RB04 UPDATED TO "VACANT (store)"

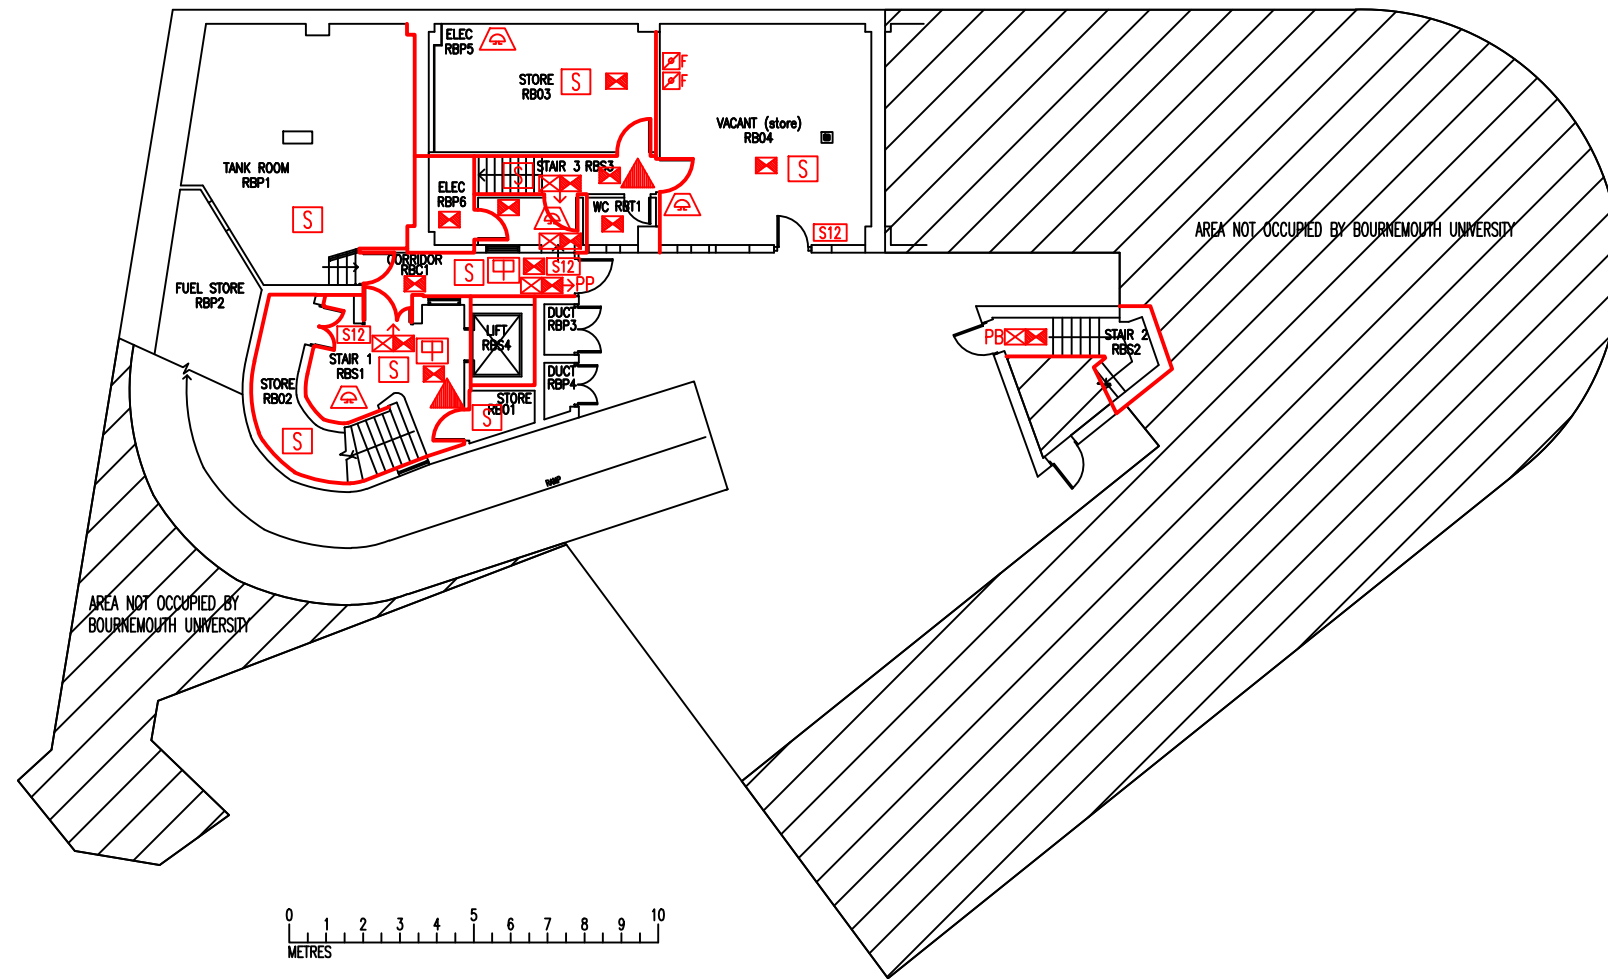

- Key to Fire Symbols
- Existing fire resisting construction 30 min.
 - Existing fire damper in wall
 - Existing 6 litre P50 foam fire extinguisher
 - Existing call point – manual
 - Existing audible warning device
 - Existing smoke detector
 - Existing exit sign – internally illuminated
 - Existing emergency lighting luminaire
 - Existing fire action sign – general
 - Existing pushpad door ironmongery

BASEMENT
FIRE EQUIPMENT
PLAN

ROYAL LONDON
HOUSE

RLH/FP/BC

SCALE 1:200 at A3
JUNE 2008

