
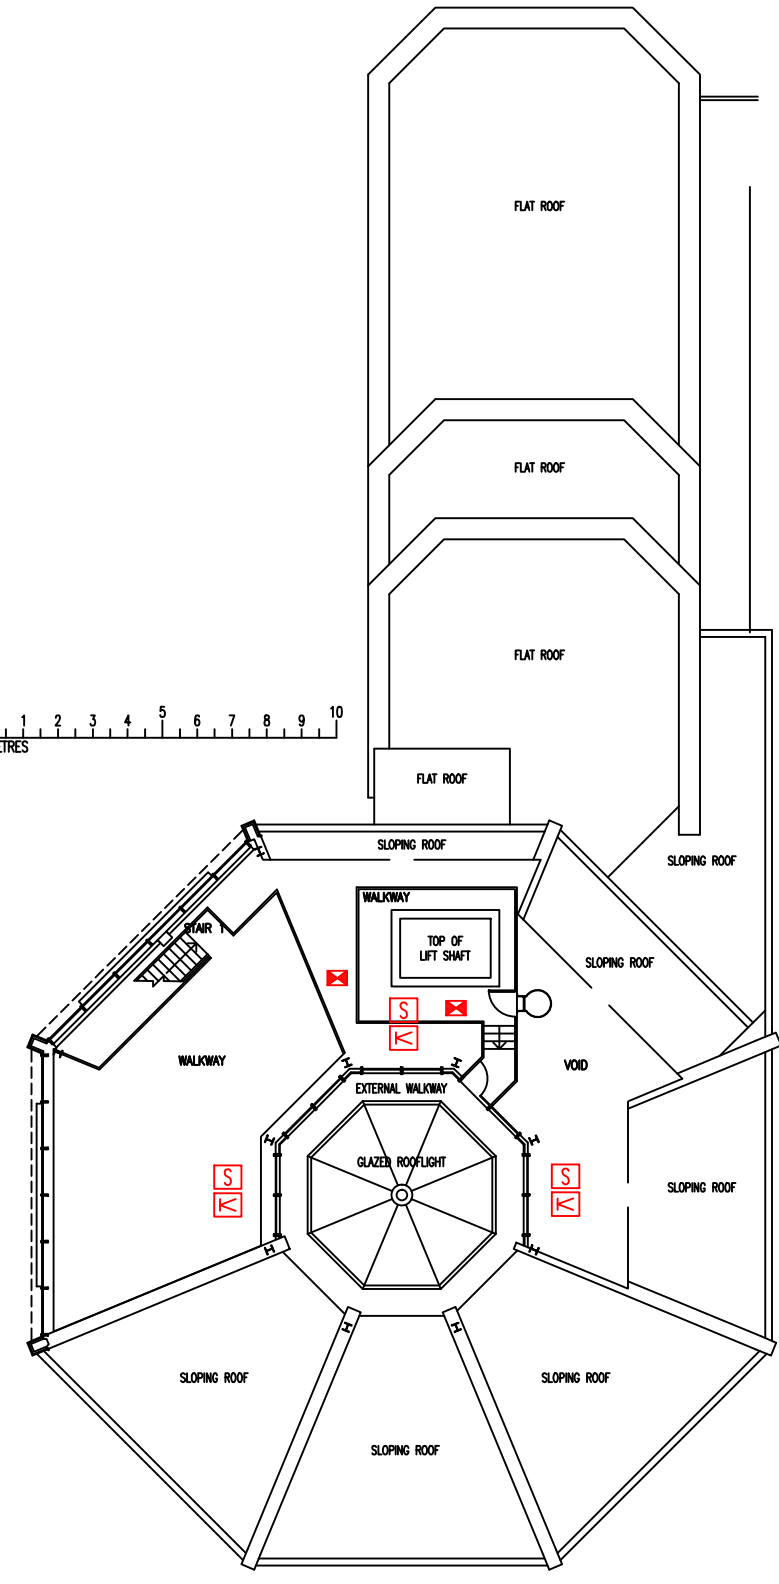


DATE	REVISION

- S Existing smoke detector
- K Existing heat detector
- ☒ Existing emergency lighting luminaire



SEVENTH FLOOR
FIRE PLAN

STUDENT CENTRE

SC/FP/8

SCALE 1:200 at A3
MARCH 2015

