



DATE	REVISION

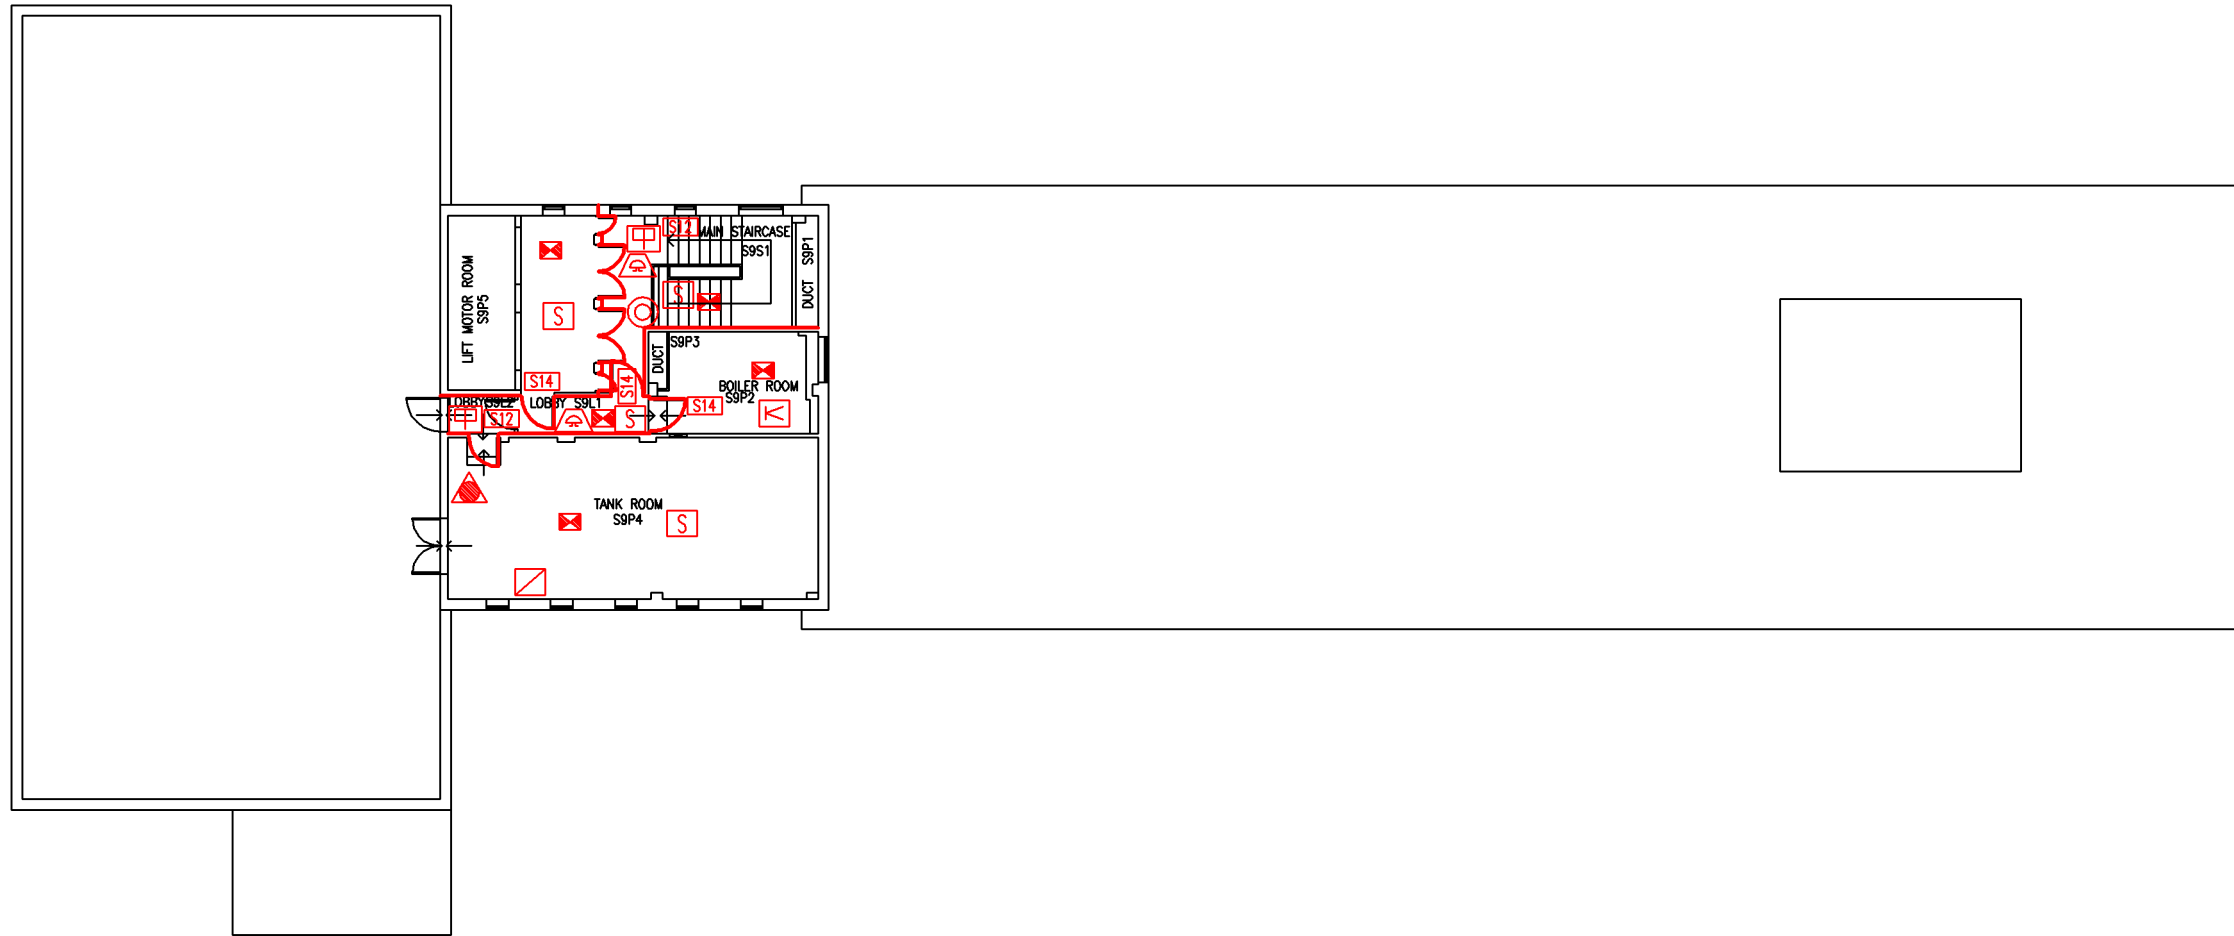

- Key to Fire Symbols (as existing 29.5.05)
- Existing fire resisting construction 30 min.
  - Existing electricity main control
  - Existing call point – manual
  - Existing foam fire extinguisher
  - Existing dry riser inlet
  - Existing emergency lighting luminaire – self contained
  - Existing audible warning device – bell
  - Existing smoke detector
  - Existing heat detector
  - Existing fire action sign – general
  - Existing fire safety sign – fire door keep locked

NINTH FLOOR  
FIRE PLAN

STUDLAND HOUSE

SH/FP/11

SCALE 1:200 at A3  
JANUARY 2006

